Motorized 3-Way Valve Wiring Instructions

AC (1ph) OR DC SUPPLY - WIRING FOR ON-OFF OR FAILSAFE ACTUATORS

POWER SUPPLY CAN BE EITHER 3 OR 2 WIRE

END OF TRAVEL CONFIRMATION

3 WIRE SYSTEM

2 WIRE SYSTEM

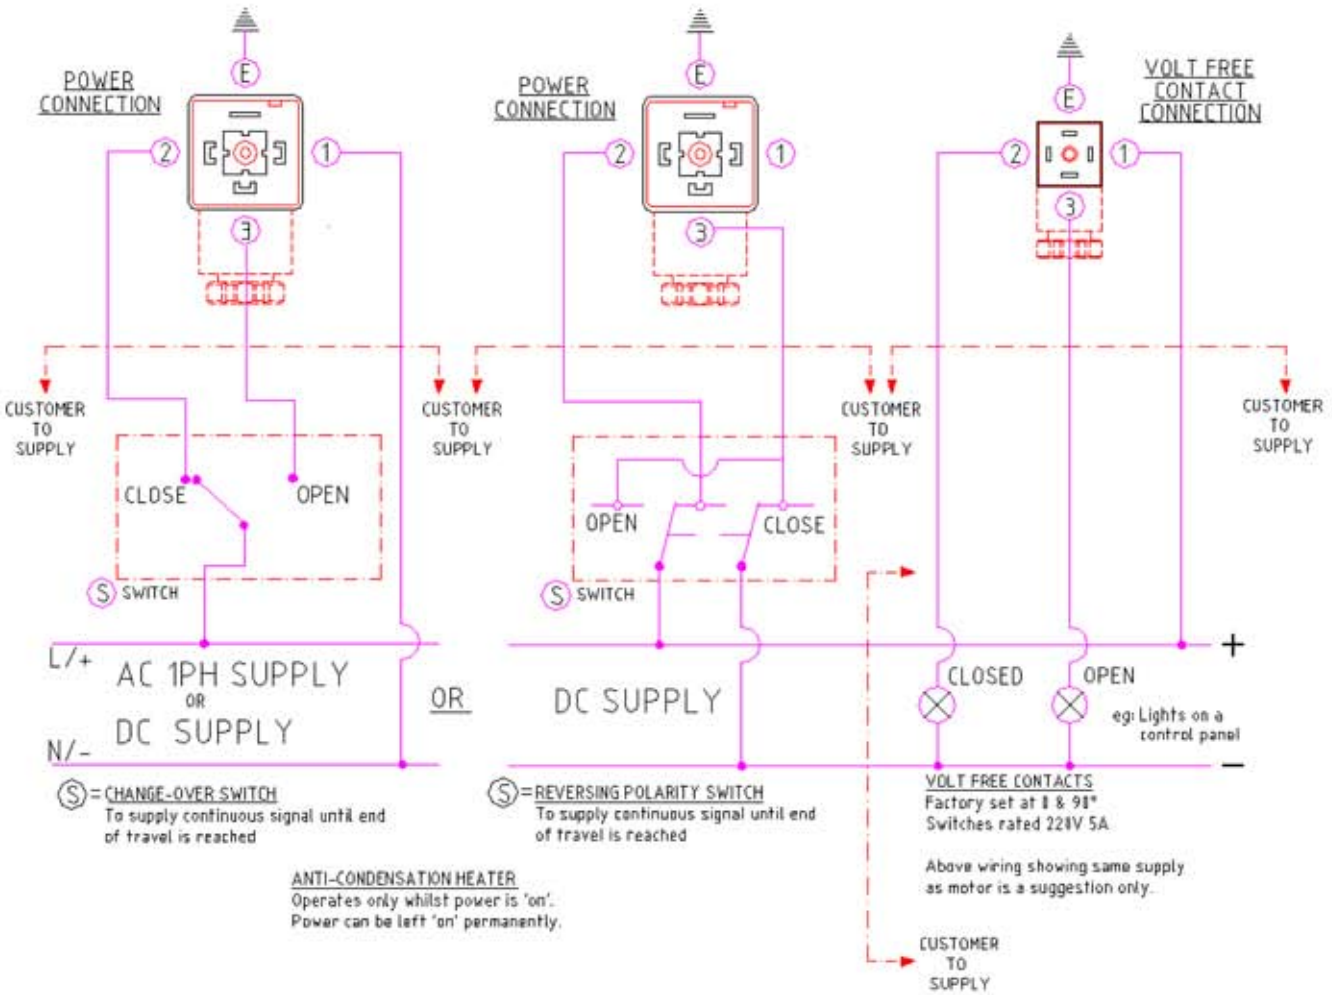

FUNCTION: ON-OFF VERSION	FUNCTION: FAILSAFE VERSION
Power open, power close Stays put on mains power failure	Power open, power close - trickle charges battery system in either open or closed position Actuator sent by battery power to pre-set failsafe position on power failure Actuator returns to pre-failure position on power resumption. Failsafe can be either NC (normally closed) or NO (normally open)